



# Radon

Please read all the instructions before sampling to ensure proper test results.

## Before Sampling



Check sampling kit for the following:

- Green hose coupler
- Tygon hose (clear and colorless)
- 2 Sample vials for each sample point
- Chain of Custody (COC)

If any of the above are missing, contact the laboratory immediately and do not attempt to collect the sample. Important: Disconnect aerators from the faucet that the samples are being taken from.

## Sampling

1. Flush the sample line for at least 10 minutes prior to collecting the sample.
2. After flushing, shut off the water flow and connect the green hose coupler to the faucet.
3. Flush for 5 minutes.
4. Uncap the sample vial and place it into the bottom of a large glass pitcher or bucket.
5. Place the clear tygon sampling hose into the sampling vial.
6. Allow the sample vial to fill and overflow.

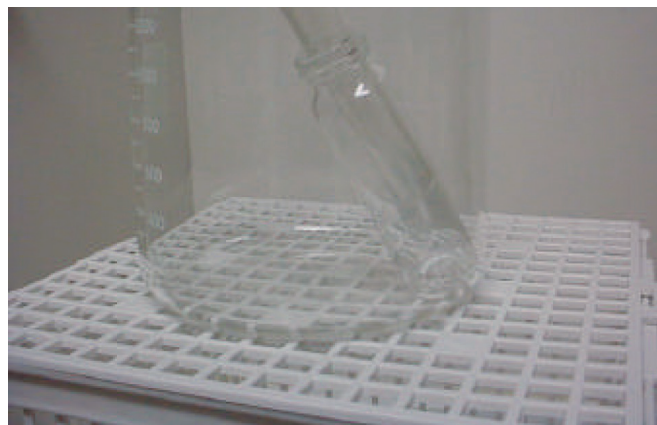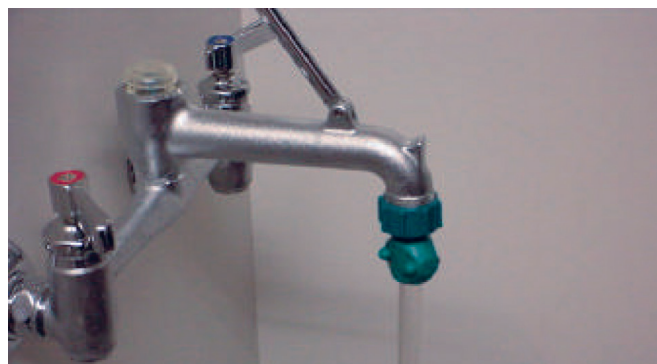

Call 1.574.233.4777 or 1.800.332.4345 or visit us at [www.ul.com/water](http://www.ul.com/water)  
UL, 110 S. Hill Street, South Bend, IN 46617



## Radon

7. Allow the vial to overflow until it is covered in pitcher/bucket by several inches of water. The pitcher/bucket may be allowed to overflow as shown.
8. Remove the hose from the vial and cap the vial while still underwater, if possible.
9. Inspect the sample for air bubbles. If bubbles exist, discard the water in the sample vial and start over.
10. Two vials should be collected from each sampling point.
11. Indicate sampling date, time, site and name of sampler on both the vial labels and the enclosed Chain of Custody. Be as specific as possible when describing the collection site.




### Shipping Instructions

- Repack the cooler with the sample vials and the green hose coupler. Seal the shipping container and return by **next day** carrier. **Alert the laboratory about incoming samples.**
- **Do not** sample or ship on Friday, Saturday, or Sunday.



*This sample has an air bubble and should be emptied and refilled*

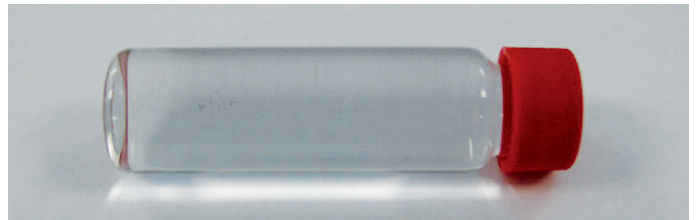

*A good sample with no air bubbles*