


Emergency Signaling Equipment - Type L Products

The Listing Mark for Emergency Signaling Equipment products covered under this product category consists of the following elements placed in close proximity and shall appear on Listed products only. Minimum size is not specified, as long as the Listing Mark is legible. The following is suggested.

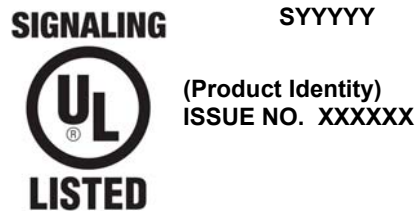

XXXXXX = The Issue number assigned by UL. The number will be assigned by UL's [Label Center](#) upon receipt of a copy of the manufacturer's purchase order for the printing of labels.

SYYYYY = The UL File number of the Applicant.

The product identity is: "EMERGENCY SIGNALING EQUIPMENT" or "EMERGENCY SIGNALING SUBASSEMBLY"

The minimum height of the registered trademark symbol ® shall be 3/64 of an inch. When the overall diameter of the UL Mark is less than 3/8 of an inch, the trademark symbol may be omitted if it is not legible to the naked eye. You may click on the logo to download a copy.

PRODUCTS ALSO LISTED TO SIGNALING, ENERGY MANAGEMENT, ITE OR TELEPHONE

Products that are also Listed by UL to other Signaling, Energy Management, Information Technology, or Telephone requirements must include a product identity "FIRE ALARM," "HOSPITAL SIGNALING AND NURSE CALL SIGNALING," "GENERAL SIGNALING," "ENCLOSED ENERGY MANAGEMENT," "INFORMATION TECHNOLOGY," or "TELEPHONE" as appropriate, followed by "EQUIPMENT" or "SUBASSEMBLY" as appropriate. If more than one is applicable, the text shall be separated by a comma.

PRODUCTS ALSO LISTED TO SECURITY REQUIREMENTS

Products that are also Listed by UL to Security requirements shall substitute the logo above with one that incorporates reference to both Security and Signaling as shown below. However, the appropriate product identity for the Security application must be included as part of the Mark.



The product identity for Security is "SECURITY EQUIPMENT" or "SECURITY SUBASSEMBLY" as appropriate.

ALTERNATIVE MARKING METHODS

The product identity may be abbreviated by a Type designation as shown below. The word "TYPE:" followed by the appropriate Type designation will be required to appear adjacent to the UL Mark. Multiple Type designations shall be separated by a comma. The Type designation shall be followed by the word "SUBASSEMBLY" as appropriate.

TYPE

S	Security Equipment
F	Fire Alarm Equipment
HN	Hospital Signaling and Nurse Call Equipment
G	General Signaling Equipment
E	Emergency Signaling Equipment
EM	Enclosed Energy Management Equipment
IT	Information Technology Equipment
T	Telephone Equipment

PROCUREMENT

The list of UL [authorized label suppliers](#) can be found on UL's online directory. A copy of the purchase order must be sent to UL's [Label Center](#) so that the layout can be reviewed, the appropriate issue number(s) assigned, and authorization provided for the supplier to reproduce the Marks.